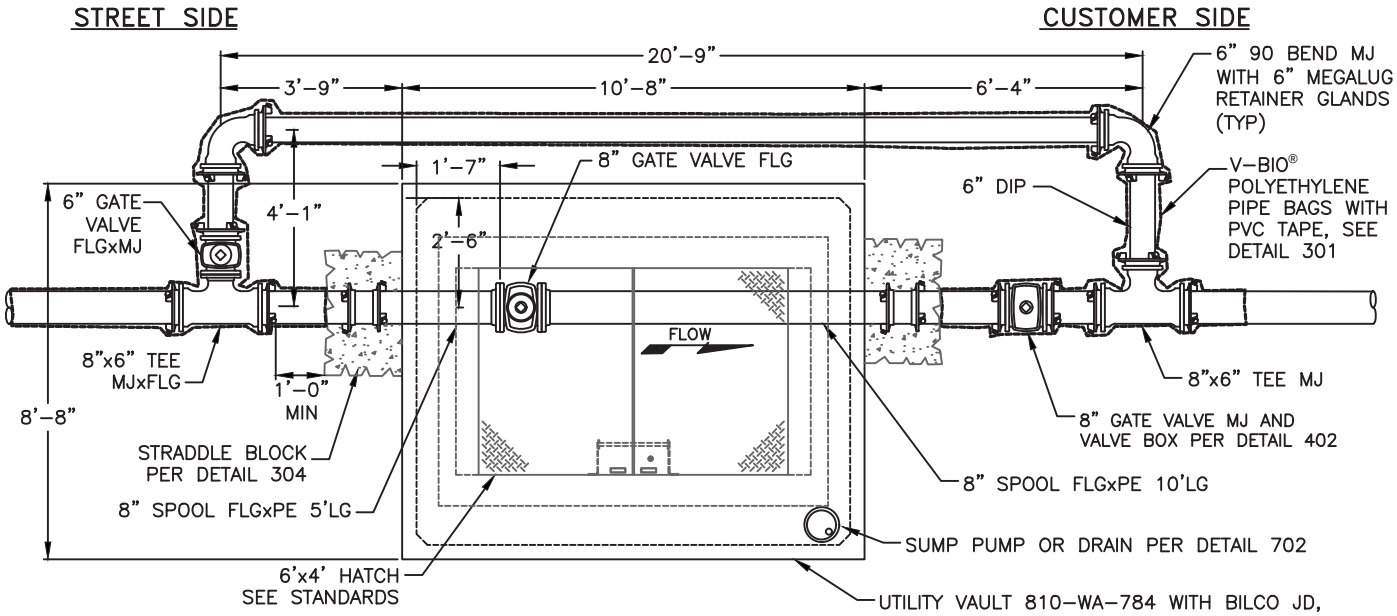

PLAN

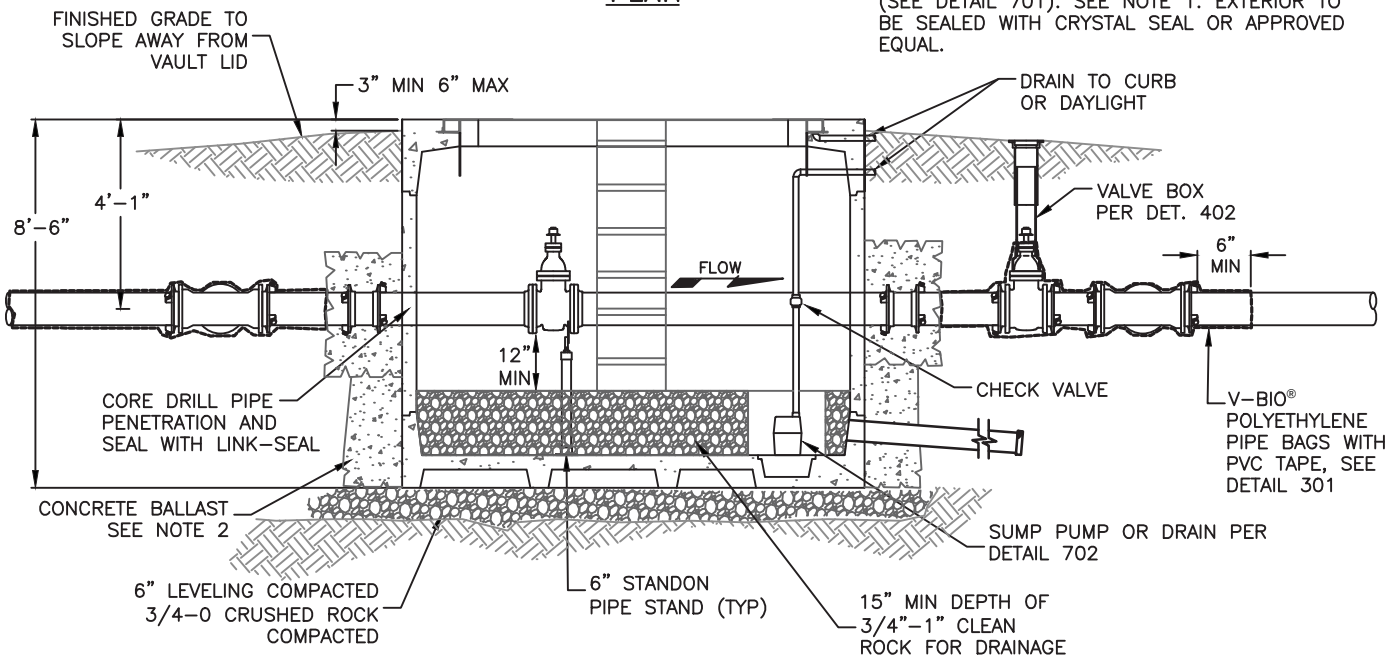

ELEVATION

NOTES:

1. CONTRACTOR SEAL ALL OPENINGS IN VAULT WITH NON SHRINK GROUT.
2. CONTRACTOR TO INSTALL CONCRETE BALLAST 3 CU YD MIN AROUND BASE OF VAULT IN AREAS WHERE FLOODING OR HIGH GROUND WATER EXISTS.
3. ALL MATERIALS SHALL BE AS NAMED OR EQUAL. SUBMIT ALTERNATES FOR APPROVAL.
4. PAINT INTERIOR WALLS AND LID BOTTOM WHITE.
5. ORS 92.044(7) PROHIBITS LOCATING ANY UTILITY INFRASTRUCTURE WITHIN 1–FT. OF A SURVEY MONUMENT. DEVELOPER SHALL PAY FOR ANY RELOCATION OF SERVICES AND/OR METER BOXES FOUND TO FALL WITHIN 1–FT. OF A SURVEY MONUMENT LOCATION.
6. FOR FIRE MAINS, USE OSY VALVE.

Tualatin Valley Water District
1850 SW 170th Ave. Beaverton, OR 97003
(503) 848-3000 www.tvwd.org

DESIGNED: KLS	8" METER INSTALLATION BY CONTRACTOR	DATE: 3/1/2018
APPROVED: NWA		DETAIL 609
SCALE: NONE		